
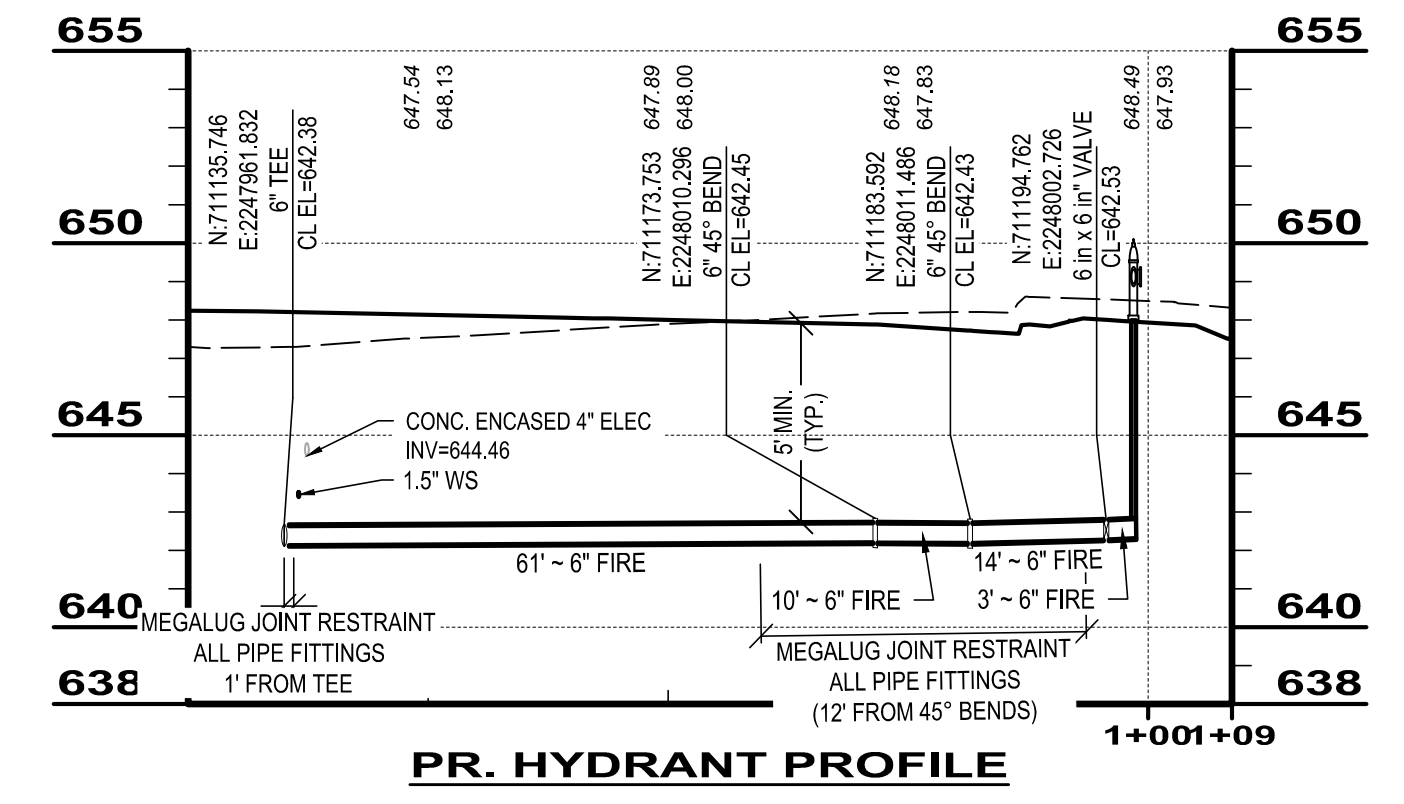


\* 4" UNDERDRAINS NOT SHOWN SEE LAYOUT FOR LOCATION AND DETAIL FOR DEPTH.  
 6" UNDERDRAINS WITH STORMTEC SYSTEM ONLY SHOWN AT CONNECTION TO MANHOLE. SEE DETAIL AND LAYOUT ON SHEETS ADS-1 & ADS-2.

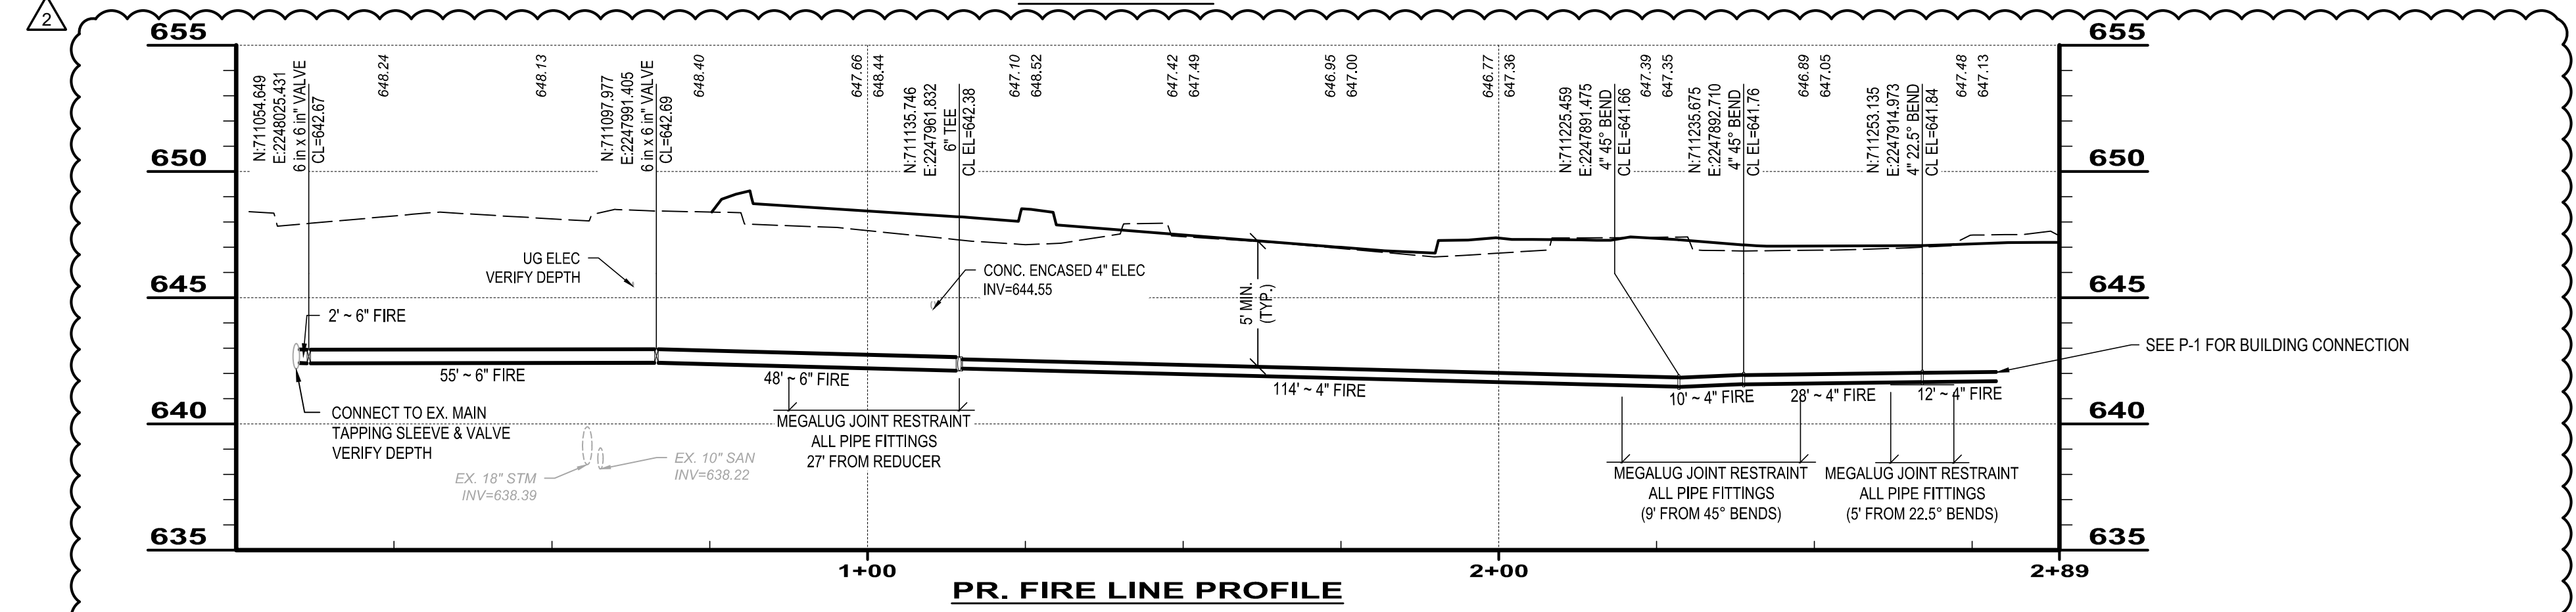

DOMESTIC BACK FLOW PREVENTER INSIDE BUILDING. SEE SHEET P-1 (#47)  
 FIRE LINE SHALL BE 4" OR 6" DUCTILE IRON PIPE, CLASS 53. 5' COVER MINIMUM.  
 DOMESTIC LINE SHALL BE 1.5" TYPE K COPPER. 4' COVER MINIMUM.

ISSUED FOR:	CD	NO	REVISION	DATE
ISSUE DATE:	4/10/20		ADDENDUM 2	5/06/20
SCALE:	1"=20'/1"=5'			
DESIGNED BY:	PJF / GMS			
DRAWN BY:	GMS			
CHECKED BY:	PJF			

LAKETRAN WICKLIFFE PARK-N-RIDE LOT  
 29610 LAKELAND BLVD., WICKLIFFE, OH 44092

PROJECT NO.	190065
DISCIPLINE	CIVIL
SHEET NAME	C-6
SHEET	8
OF	49

STORM PROFILES